

Dimensions and Performance Data

Nominal Size HxWxD	Actual Dimensions HxWxD	Approximate Weight (lbs.)	Media Area (sq. ft.)
12 x 24 x 12	11 3/8 x 23 3/8 x 11 1/2	8.2	97
20 x 20 x 12	19 3/8 x 19 3/8 x 11 1/2	12.0	120
20 x 24 x 12	19 3/8 x 23 3/8 x 11 1/2	13.4	162
24 x 24 x 12	23 3/8 x 23 3/8 x 11 1/2	16.3	193

Options

Filter Efficiency (75%, 85%, 95%, 98%, or R (98% DOP))	
UL 900 Class 1 or Class 2 (Please consult factory for Class 1)	
Double Header (not available on all sizes, please consult factory)	
Metal Wrap (not available on all sizes, please consult factory)	
Regular or Hi-Temperature	
1/4" Thick Neoprene Gasket (Upstream, Downstream, Side (specify side(s)))	
FP Glove (Type 1 (Downstream) or Type 2 (Upstream)) (Not available in all sizes, please consult factory)	

Specifications

Actual Size (Height and Width)	Dimension - 5/8"
Actual Size (Depth)	Dimension - 1/2"
Maximum Constant Temperature	Standard: 150°F
	High Temp: 250°F
Flammability	UL 900 Class 2
	UL 900 Class 1 (consult factory)
Media	Wet Laid Fiberglass
Relative Humidity*	100%
Recommended Final Pressure Drop	2.0" w.g.


*Not recommended for extended periods

YOUR APPROVAL OF THIS PRINT AUTHORIZES FILTRATION GROUP, INC. TO PROCEED WITH MATERIAL PROCUREMENT, TOOLING AND PRODUCT FABRICATION. ANY CHANGES MADE AFTER APPROVAL MAY INCUR FURTHER EXPENSES TO THE CUSTOMER.

For Sales Only

Customer Information: _____

Item Number: _____

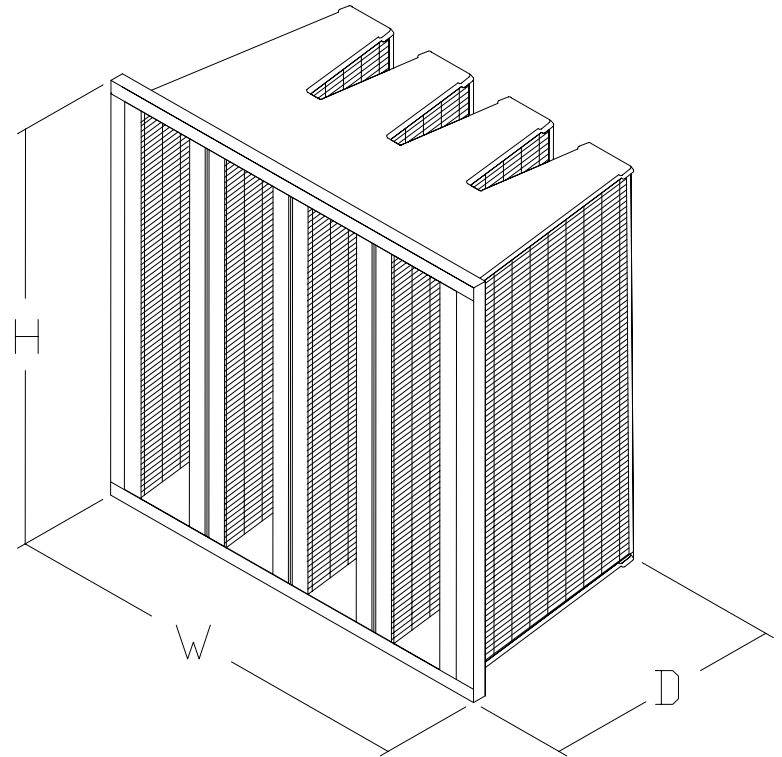

For Non-Standard Sizes, Please Consult the Factory.

_____ (A) X _____ (H) X _____ 12 _____ (D)

Please Specify Size as Nominal or Exact _____

Customer Initial and Date for Non-Standard Size _____



Filtration Group, Inc.
912 East Washington Street
Joliet, Illinois 60433

FP V-Bank


Mini-Pleat Filters

DR: JMB	Date: 3/22/02	Drawing Number:	Revision:
Page: 1 of 2		SD-FP-V-BANK 00	

Technical Data

FP Mini-Pleat 24 x 24 x 12	75%			85%			95%			98%			R		
	2000	2500	3000	2000	2500	3000	2000	2500	3000	2000	2500	3000	2000	2500	3000
Air Flow (CFM)	2000	2500	3000	2000	2500	3000	2000	2500	3000	2000	2500	3000	2000	2500	3000
Initial Pressure Drop (inch w.g.)	0.25	0.38	0.60	0.27	0.40	0.60	0.36	0.51	0.64	0.61	0.81	*	0.76	1.00	*
Average Atmospheric Efficiency (ASHRAE 52.1) @ 2000 CFM	75%			85%			95%			98%			>99%		
MERV (ASHRAE 52.2) @ 2000 CFM	MERV 10			MERV 11			MERV 13			MERV 15			MERV 16		
Initial DOP Efficiency 0.3 µm (Mil Std. 282) @ 2000 CFM	N/A			N/A			N/A			89%			98%		

* Not recommended

	Filtration Group, Inc.				
	912 East Washington Street Joliet, Illinois 60433				
FP V-Bank					
Mini-Pleat Filters					
DR:	JMB	Date:	3/22/02	Drawing Number:	Revision:
Page:		2 of 2		SD-FP-V-BANK 00	

YOUR APPROVAL OF THIS PRINT AUTHORIZES FILTRATION GROUP, INC. TO PROCEED WITH MATERIAL PROCUREMENT, TOOLING AND PRODUCT FABRICATION. ANY CHANGES MADE AFTER APPROVAL MAY INCUR FURTHER EXPENSES TO THE CUSTOMER.